

University of Kurdistan

Dept. of Electrical and Computer Engineering

Smart/Micro Grid Research Center

smgrc.uok.ac.ir

Robust Coordinated AVR-PSS Design Using H^∞ Static Output Feedback Control

H. Bevrani & T. Hiyama

Published (to be published) in: *IEEJ Transactions on Power and Energy*

(Expected) publication date: **2007**

Citation format for published version:

Bevrani, Hassan & Hiyama, Takashi (2007) Robust coordinated AVR-PSS design using H^∞ static output feedback control. *IEEJ Transactions on Power and Energy*, vol. 127(1), pp. 70-76,

Copyright policies:

- Download and print one copy of this material for the purpose of private study or research is permitted.
- Permission to further distributing the material for advertising or promotional purposes or use it for any profit-making activity or commercial gain, must be obtained from the main publisher.
- If you believe that this document breaches copyright please contact us at smgrc@uok.ac.ir providing details, and we will remove access to the work immediately and investigate your claim.

Robust Coordinated AVR-PSS Design Using H_∞ Static Output Feedback Control

Hassan Bevrani* Member
Takashi Hiyama* Member

This paper addresses a new robust control methodology to enhance the power system stability and voltage regulation as an integrated design approach. The automatic voltage regulation (AVR) and power system stabilizer (PSS) design problems are reduced to solve a single H_∞ based static output feedback control problem. To determine the optimal gains, an iterative linear matrix inequalities (LMI) algorithm is used. A four-machine infinite-bus system example is given to demonstrate the efficiency of developed approach. The proposed robust technique is shown to maintain the robust performance and minimize the effects of disturbances, properly.

Keywords: H_∞ control, static output feedback, LMI, voltage regulation, power system stabilizer, robust performance

1. Introduction

Power systems continuously experience changes in operating conditions due to variations in generation/load and a wide range of disturbances⁽¹⁾. Power system stability and voltage regulation have been considered as an important problem for secure system operation over the years. Currently, because of expanding physical setups, functionality and complexity of power systems, the mentioned problem becomes a more significant than the past. That is why in recent years a great deal of attention has been paid to application of advanced control techniques in power system as one of the more promising application areas.

Conventionally, the automatic voltage regulation and power system stabilizer (AVR-PSS) design is considered as a sequential design including two separate stages. Firstly, the AVR is designed to meet the specified voltage regulation performance and then the PSS is designed to satisfy the stability and required damping performance. It is well known that the stability and voltage regulation are ascribed to different model descriptions, and it has been long recognized that AVR and PSS have inherent conflicting objectives.

In the conventional AVR-PSS⁽²⁾, the PSS consisting of a gain in series with lead-lag structure, generating a stabilizing signal to modulate the reference of the AVR which is essentially a first order lag controller. The phase compensation needed is often quite large; hence it often results in the saturation of the PSS, especially if it is constructed out of analog components. Furthermore, the achievable performance of the PSS may be limited by the structure and closed-loop tuning of the AVR⁽³⁾.

The conflict between voltage regulation and damping are well addressed in Ref. (3)~(5). In Ref. (3) and (4) it is analytically shown that for an ideal AVR design without any internal pre-compensation, the AVR is detrimental to the inherent system damping. A result for constant AVR gain is stated in Ref. (5). Interested readers can refer to the mentioned references to see the analysis detail. From the performed studies, it can be deduced that the successful achievement of both goals using nonintegrated design approach turns out to be very difficult. Therefore, it is reasonable to realize a compromise between the desired stability and regulation performances by a unique controller.

In the last two decades, some studies have considered an integrated design approach to AVR and PSS design using domain partitioning⁽⁵⁾, robust pole-replacement⁽⁶⁾ and adaptive control⁽⁷⁾. Recently, several control methods have been made to coordinate the various requirements for stabilization and voltage regulation within the one controller⁽⁸⁻¹²⁾. A desensitized controller based on Linear Quadratic Gaussian (LQG) optimal technique is used in Ref. (8). An approach used in Ref. (3), (4) involves use of Internal Model Control (IMC) method to make a trade-off between voltage regulation and power system stabilization. Although all above approaches have used linear control techniques, because of complexity of control structure, numerous unknown design parameters and neglecting real constraints, they are not well suited to meet the design objectives for a multi-machine power system. Some proposed scenarios apply a switching strategy of two different kinds of controller to cover the different behavior of system operation during transient period and post-transient period⁽⁹⁻¹¹⁾. The performance of these schemes essentially depends upon the selection of switching time. Moreover, using different control surfaces through a highly nonlinear structure increases the complexity of designed

* Department of Computer Science and Electrical Eng., Kumamoto University, Kumamoto 860-8555.

controllers. As a preliminary step of this work, the authors have addressed the problem of a robust control methodology to enhance the stability and voltage regulation of a single-machine infinite bus in the presence of conventional PSS and AVR equipments⁽¹²⁾.

In this paper, the stabilization and voltage regulation considering the practical constraints for feasibility are formulated via an H ∞ static output feedback (H ∞ -SOF) control problem which it can be easily solved using an iterative linear matrix inequalities (LMI) algorithm. The resulting controller is not only robust but it also allows direct and effective trade-off between voltage regulation and damping performance. The proposed controller uses the measurable signals and has merely proportional gains; so gives considerable promise for implementation, especially in a multi-machine system. In fact the proposed control strategy attempts to make a bridge between the simplicity of control structure and robustness of stability and performance to satisfy the simultaneous AVR and PSS tasks. In order to show the effectiveness of this methodology, it is applied to a four-machine infinite-bus system. The obtained results are compared with a full-order dynamic H ∞ output feedback control design.

2. A Background on H ∞ -SOF Control Design

This section gives a brief overview for the H ∞ based static output feedback (H ∞ -SOF) control design. Consider a linear time invariant system $G(s)$ with the following state-space realization.

$$\begin{aligned} \dot{x}_i &= A_i x_i + B_{1i} w_i + B_{2i} u_i \\ G_i(s): z_i &= C_{1i} x_i + D_{12i} u_i \quad \dots\dots\dots (1) \\ y_i &= C_{2i} x_i \end{aligned}$$

where x_i is the state variable vector, w_i is the disturbance and area interface vector, z_i is the controlled output vector and y_i is the measured output vector. The A_i , B_{1i} , B_{2i} , C_{1i} , C_{2i} and D_{12i} are known real matrices of appropriate dimensions.

The H ∞ -SOF control problem for the linear time invariant system $G_i(s)$ with the state-space realization of (1) is to find a gain matrix K_i ($u_i = K_i y_i$), such that the resulted closed-loop system is internally stable, and the H ∞ norm from w_i to z_i (Fig. 1) is smaller than γ , a specified positive number, i.e.

$$\|T_{z_i w_i}(s)\|_{\infty} < \gamma \quad \dots\dots\dots (2)$$

It is notable that the H ∞ -SOF control problem can be transferred to a generalized SOF stabilization problem which is expressed via the following theorem⁽¹³⁾.

Theorem. The system (A, B, C) is stabilizable via SOF if and only if there exist $P > 0$, $X > 0$ and K_i satisfying the following quadratic matrix inequality

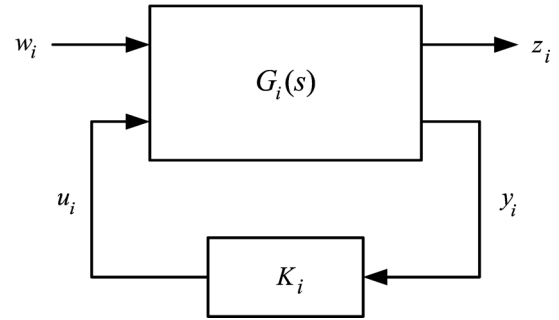


Fig. 1. Closed-loop system via H ∞ -SOF control

$$\begin{bmatrix} A^T X + XA - PBB^T X - XBB^T P + PBB^T P & (B^T X + K_i C)^T \\ B^T X + K_i C & -I \end{bmatrix} < 0 \quad \dots\dots\dots (3)$$

Here, the matrices A , B and C are constant and have appropriate dimensions. The X and P are symmetric and positive-definite matrices.

Since a solution for the consequent non convex optimization problem (3) can not be directly achieved by using general LMI technique⁽¹⁴⁾, a variety of methods were proposed by many researchers with many analytical and numerical methods to approach a local/global solution. In this paper, to solve the resulted SOF problem, an iterative LMI is used based on the existence necessary and sufficient condition for SOF stabilization, via the H ∞ control technique.

3. Proposed Control Strategy

3.1 Modeling In order to design a robust power system controller, it is first necessary to consider an appropriate linear mathematical description of multi-machine power system with two axis generator models. In the view point of generator unit "i", the state space representation model for such a system has the form

$$\begin{aligned} \dot{x}_{1i} &= x_{2i} \\ \dot{x}_{2i} &= -(D_i/M_i)x_{2i} - (1/M_i)\Delta P_{ei}(x) \\ \dot{x}_{3i} &= -(1/T'_{d0i})x_{3i} - (\Delta x_{di}(x)/T'_{d0i})\Delta I_{di}(x) + u_i \quad \dots \quad (4) \\ \dot{x}_{4i} &= -(1/T'_{q0i})x_{4i} - (\Delta x_{qi}(x)/T'_{q0i})\Delta I_{qi}(x) \end{aligned}$$

where the states

$$x_i^T = [x_{1i} \quad x_{2i} \quad x_{3i} \quad x_{4i}] = [\delta_i \quad \omega_i \quad E'_{qi} \quad E'_{di}] \dots\dots\dots (5)$$

are defined as deviation form the equilibrium values

$$x_{ei}^T = [\delta_{1i}^e \quad \omega_{2i}^e \quad E'_{qi}{}^e \quad E'_{di}{}^e]$$

and, here

$$\Delta x_{di} = x_{di} - x'_{di}, \Delta x_{qi} = x_{qi} - x'_{di} \quad \dots\dots\dots (6)$$

$$\Delta P_{ei}(x) = (E'_{di}I_{di} + E'_{qi}I_{qi}) - (E''_{di}I''_{di} + E''_{qi}I''_{qi}) \quad \dots\dots\dots (7)$$

$$I_{di} = \sum_k [G_{ik} \cos \delta_{ik} + B_{ik} \sin \delta_{ik}] E'_{dk} + \sum_k [G_{ik} \sin \delta_{ik} - B_{ik} \cos \delta_{ik}] E'_{qk} \quad \dots\dots\dots (8)$$

$$I_{qi} = \sum_k [B_{ik} \cos \delta_{ik} - G_{ik} \sin \delta_{ik}] E'_{dk} + \sum_k [G_{ik} \cos \delta_{ik} + B_{ik} \sin \delta_{ik}] E'_{qk} \quad \dots\dots\dots (9)$$

A detailed description of all symbols and quantities can be found in Ref. (15). Using the linearization technique and after some manipulation, the nonlinear state equations (5) can be expressed in the form of following linear state space model.

$$\dot{x}_i = A_i x_i + B_i u_i \quad \dots\dots\dots (10)$$

where

$$A_i = \begin{bmatrix} 0 & 1 & 0 & 0 \\ a_{21} & -\frac{D_i}{M_i} & a_{23} & a_{24} \\ a_{31} & 0 & a_{33} & -\frac{G_{ii}\Delta x_{di}}{T'_{d0i}} \\ a_{41} & 0 & \frac{G_{ii}\Delta x_{qi}}{T'_{q0i}} & a_{44} \end{bmatrix}, B_i = \begin{bmatrix} 0 \\ 0 \\ 1 \\ 0 \end{bmatrix} \quad \dots\dots\dots (11)$$

with elements that are given in Appendix.

3.2 Overall Control Framework The overall control structure is shown in Fig. 2, where the conventional power system stabilizer and automatic voltage regulator blocks are replaced by a single H ∞ -SOF controller including the following optimal gain vector.

$$K_i^T = [k_{vi} \quad k_{pi} \quad k_{oi}] \quad \dots\dots\dots (12)$$

The H ∞ -SOF controller uses the terminal voltage Δv_{ti} , electrical power Δp_{ei} and machine speed $\Delta \omega_i$ as input signals, which all of them are easily measurable in a real power system environment. Δv_{refi} and d_i show the reference voltage deviation and system disturbance input, respectively.

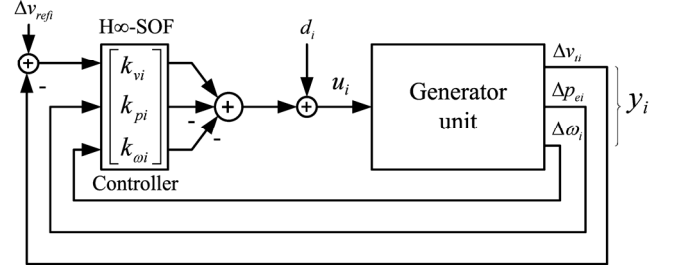


Fig. 2. Overall control structure

Using linearized model for a given power system unit “ i ” in the form of (1) and performing the standard H ∞ -SOF configuration (Fig. 1) with considering an appropriate controlled output signals results an effective control framework, which is shown in Fig. 3. This control structure adapts the H ∞ -SOF control technique with the described power system control targets and allows direct trade-off between voltage regulation and closed-loop stability by optimal tuning of a pure vector gain. Here, disturbance input vector w_i , controlled output vector z_i and measured output vector y_i are considered as follows:

$$w_i^T = [\Delta v_{refi} \quad d_i] \quad \dots\dots\dots (13)$$

$$z_i^T = [\mu_{1i}\Delta v_{ti} \quad \mu_{2i}\Delta \delta_i \quad \mu_{3i}\Delta P_{ei} \quad \mu_{4i}u_i] \quad \dots\dots\dots (14)$$

$$y_i^T = [\Delta v_{ti} \quad \Delta p_{ei} \quad \Delta \omega_i] \quad \dots\dots\dots (15)$$

where $\mu_i = [\mu_{1i} \quad \mu_{2i} \quad \mu_{3i} \quad \mu_{4i}]$ is a constant weight vector that must be chosen by designer to get the desired closed-loop performance. The selection of constant weights μ_{1i} , μ_{2i} and μ_{3i} is dependent on specified voltage regulation and damping performance goals. In fact an important issue with regard to selection of these weights is the degree to which they can guarantee the satisfaction of design performance objectives. One can simply fix the weights to unity and use the method with regional pole placement technique for performance tuning⁽¹⁶⁾.

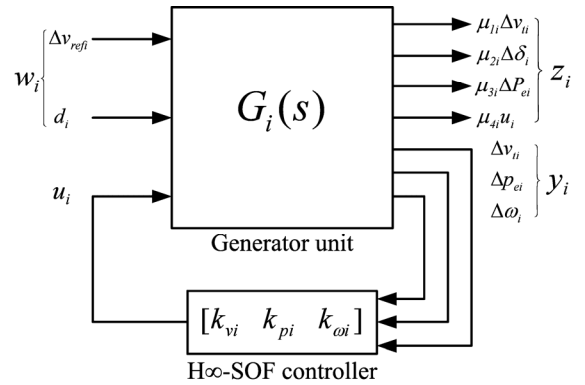


Fig. 3. The proposed H ∞ -SOF control framework

The selection of these weights entails a compromise among several performance requirements. Furthermore, μ_{4i} sets a limit on the allowed control signal to penalize fast changes, large overshoot with a reasonable control gain to meet the feasibility and the corresponded physical constraints.

Since the vector z_i properly covers all significant controlled signals which must be minimized by an ideal AVR-PSS design, it is expected that the proposed robust controller to be able to satisfy the voltage regulation and stabilizing objectives, simultaneously.

As we know, considering the speed deviation as control input signal, the conventional PSS is structurally composed of phase-lead compensator(s), which acts like as a proportional-derivative (PD) controller. The proposed control system has the feedbacks from speed and electric power deviation signals, and, actually these two signals give the PD information of generator speed. Furthermore, the additional feedback for the voltage deviation is similar to the used one in the conventional AVR (with a quite small time delay) for the measurement of voltage signal.

It is notable that, since the solution must be obtained through the minimizing of an H_∞ optimization problem, the designed controller satisfies the robust stability and voltage regulation performance for the closed-loop system. Moreover, the developed iterative LMI algorithm (which is described in the next section) provides an effective and flexible tool to find an appropriate solution in the form of a simple static gain controller.

3.3 An Iterative LMI Algorithm In order to solve the H_∞ -SOF, an iterative LMI algorithm has been used. Similar to the given approach in Ref. (17), (18), the key point is to formulate the H_∞ problem via a generalized static output stabilization feedback such that all eigenvalues of $(A-B K_i C)$ shift towards the left half plane in the complex s-plane, to close to feasibility of (3). The described theorem in the previous section gives a family of internally stabilizing SOF gains is defined as K_{sof} . But the desirable solution K_i is an admissible SOF law

$$u_i = K_i y_i, K_i \in K_{sof} \quad \dots \quad (16)$$

such that

$$\|T_{zi wi}(s)\|_\infty < \gamma^*, |\gamma - \gamma^*| < \varepsilon \quad \dots \quad (17)$$

where ε is a small positive number. Suboptimal performance index γ^* indicates a lower bound such that the closed-loop system is H_∞ stabilizable. The optimal performance index (γ), can be obtained from the application of a full dynamic H_∞ dynamic output feedback control method.

The proposed algorithm, which is described in Fig. 4, gives an iterative LMI suboptimal solution for above optimization problem. Here A_g, B_g and C_g are three generalized matrices of the following forms

$$A_g = \begin{bmatrix} A_i & B_{1i} & 0 \\ 0 & -\gamma I/2 & 0 \\ C_{1i} & 0 & -\gamma I/2 \end{bmatrix}, B_g = \begin{bmatrix} B_{2i} \\ 0 \\ D_{12i} \end{bmatrix}, C_g = [C_{2i} \quad 0 \quad 0]. \quad \dots \quad (18)$$

The proposed iterative LMI algorithm shows that if we simply perturb A_g to $A_g - (a/2)I$ for some $a > 0$, then we will find a solution ($\bar{X} > 0, K$) of the matrix inequality (3) for the performed generalized plant. That is, there exist a real number ($a > 0$) and a matrix $P > 0$ to satisfy inequality (II) given in Fig. 4. Consequently, the closed-loop system matrix $A_g - B_g K C_g$ has eigenvalues on the left-hand side of the line $\Re(s) = a$ in the complex s-plane. Based on the idea that all eigenvalues of $A_g - B_g K C_g$ are shifted progressively towards the left half plane through the reduction of a . The given generalized eigenvalue minimization in the developed iterative LMI algorithm guarantees this progressive reduction.

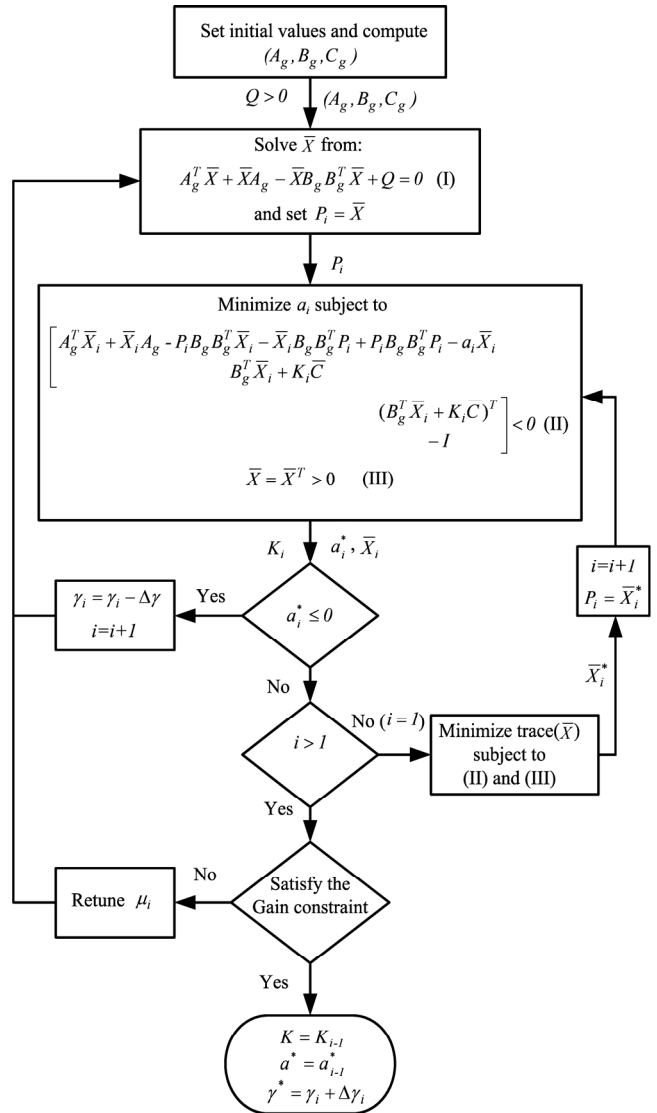


Fig. 4. Iterative LMI algorithm

The selection method for the constant weight vector μ_i , includes the following steps:

Step 1. Set initial values,

Step 2. Run the iterative LMI algorithm shown in Fig. 4,

Step 3. If the ILMI algorithm gives a feasible solution such that satisfies the robust H_∞ performance and the gain constraint; the assigned weights vector is acceptable. Otherwise retune μ_i and go to Step 2.

4. Application to a 4-Machine Infinite Bus System

To illustrate the effectiveness of the proposed control strategy, a longitudinal four-machine infinite bus system, is considered as a test system ^{(19), (20)}. The study system is shown in Fig. 5. All units are thermal type, and units 2, 3 and 4 have a separately conventional excitation control system as shown in Fig. 6 and Fig. 7. The generators, lines and conventional excitation system parameters are given in Table 1, Table 2 and Table 3 (Appendix). Here, for the simulation purpose, 1000 is considered as the system base MVA.

Unit 1 is selected to be equipped with robust control, and therefore our objective is to apply the control strategy developed in the previous section to controller design for unit 1. It is assumed this unit has an exciter part same as the shown "Exciter" block in Fig. 7.

First of all, using *hinflmi* function in LMI toolbox of MATLAB software ⁽²¹⁾, a full order robust dynamic controller with the following structure is designed.

$$K_I(s): \begin{cases} \dot{x}_K = A_K x_K + B_K y_I \\ u_I = C_K x_K + D_K y_I \end{cases} \dots\dots\dots (19)$$

Then, applying the proposed H_∞ -SOF control methodology an optimal gain vector for the problem at hand is obtained as follows. The value of 10 is considered as upper limit for the gains of vector's arrays. The used constant weight vector (μ_i) is given in Appendix.

$$K_{I,SOF} = [9.9897 \quad 8.9987 \quad 1.5986] \dots\dots\dots (20)$$

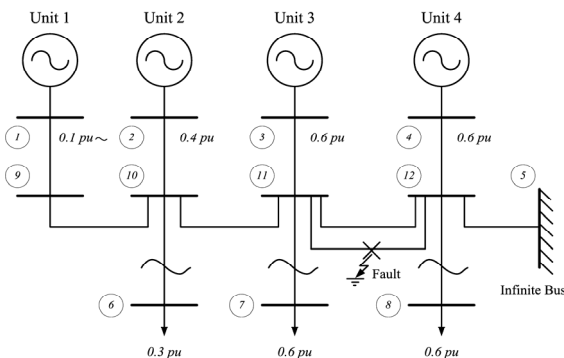


Fig. 5. Four-machine infinite-bus power system

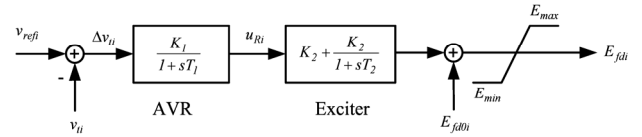


Fig. 6. Conventional excitation control system for units 2 and 3

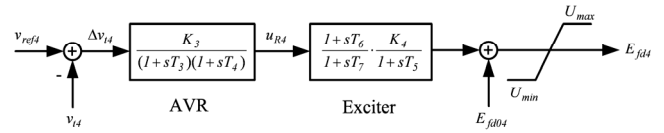


Fig. 7. Conventional excitation control system for unit 4

The considered constraints on limiters and control loop gains are set according to the real power system control units and close to ones that exist for the conventional AVR_PSS units. In the simulated example, since the conventional PSS gain and the AVR gain have been set to 10, to perform the fair comparisons between the conventional PSS-AVR and the proposed controller, both feedback gains k_{vi} and k_{pi} have been set to be less than 10. Also, in comparison of conventional P+ ω type PSS, the assigned gain for k_{oi} is small enough.

In a real power system, the excitation voltage should be not rise from the accepted level after applying the shutdown test to the target generator. The gain setting for the proposed controller does not give any unacceptable excitation voltage rise during the shutdown test. When never applying the shutdown test, the PSS is usually locked among a quite short time after opening the generator circuit breaker. Therefore, even if the gains are little bit higher, then there still does not cause any problem for the excitation voltage increase.

The closed loop performance analysis shows that the resulted robust performance indices (γ and γ^*) of both synthesis methods are very close to each other (Table 4). It indicates that although the proposed H_∞ -SOF approach gives a much simpler controller (pure gain) than the H_∞ dynamic output feedback design, it holds robust performance as well as dynamic H_∞ controller.

5. Simulation Results

In order to demonstrate the effectiveness of the proposed strategy, some simulations were carried out. The performance of the closed-loop system in comparison of a full-order dynamic H_∞ output feedback controller is tested in the presence of voltage deviation, faults and system disturbance. During the simulation, the output setting of unit 1 is fixed to 0.6 pu.

Fig. 8 shows the electrical power, terminal voltage and machine speed of unit 1, and the electrical powers of other units, following a fault on the line between buses 11 and 12 at 2 sec. The fault is continued for 4 cycles. As the next test case, the performance of designed controllers was evaluated in the presence of a 0.05 pu step disturbance injected at the voltage reference input of unit 1 at 20 sec.

Fig. 9 shows the closed-loop response of the power systems fitted with the dynamical H_∞ controller and the proposed robust gain vector.

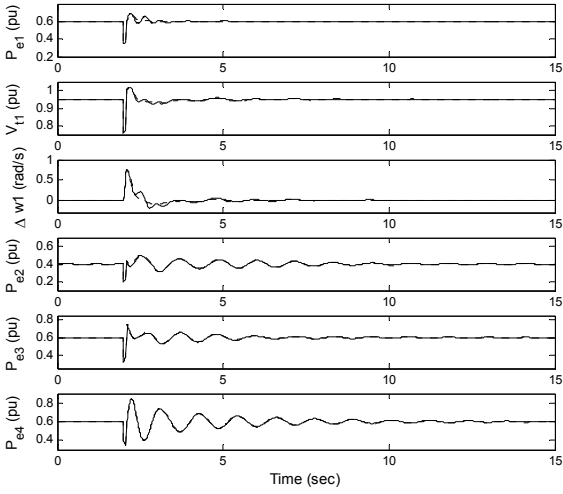


Fig. 8. System response for a fault between buses 11 and 12; Solid (H_∞ -SOF), dotted (H_∞ -Dynamic)

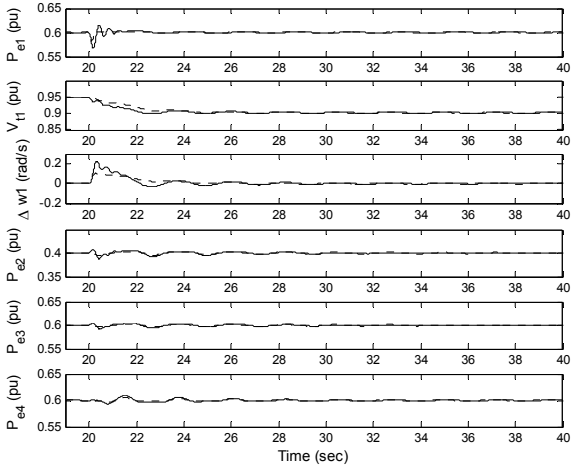


Fig. 9. System response for a 0.05 pu step change at the voltage reference input of unit 1; Solid (H_∞ -SOF), dotted (H_∞ -Dynamic)

System response in the face of a step disturbance (d_i) with one second duration in the closed-loop system at 20 sec, is shown in Fig. 10. Comparing the simulation results shows that the robust design achieves robustness against the voltage deviation, disturbance and line fault with a quite good performance as well as full dynamical H_∞ controller. Furthermore, practically it is highly desirable, for reasons of simplicity of structure and flexibility of design methodology. Table 4 shows a comparison between the proposed H_∞ -SOF and H_∞ -Dynamic approaches in view point of structure, robust performance indices and the critical power output from unit 1 for a three-phase to ground fault (between buses 11 and 12 in Fig. 5). To investigate the critical point, the real power output of unit 1 is increased from 0.1 pu (The setting of the real power

output from the other units is fixed at the values shown in Fig. 5).

The size of resulted stable region by both methods is approximately equal, and it is significantly enlarged in comparison of conventional AVR-PSS controller. Using the conventional AVR-PSS structure, the resulted critical power output from unit 1 to be 0.31 pu^{(19), (20)}; and in case of tight tuning of parameters it will not to be higher than 0.5 pu.

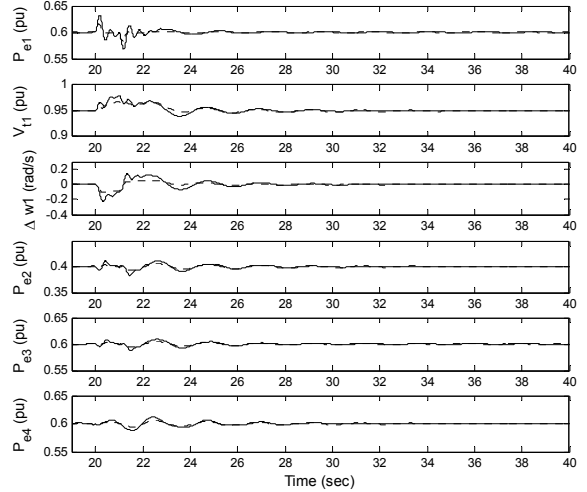


Fig. 10. System response for a step disturbance at 20 sec; Solid (H_∞ -SOF), dotted (H_∞ -Dynamic)

Finally, to demonstrate the simultaneous damping of local (fast) and global (slow) oscillation modes, filtering analysis has been performed. For the study system, the local mode for each corresponding unit, and the low frequency global mode are around 1.5 Hz and 0.3 Hz, respectively. The simulation results for the speed deviation of unit 1, following a fault on the line between buses 11 and 12 are shown in Fig. 11. The results are compared with a tight-tuned conventional AVR-PSS type⁽¹⁹⁾ in a stable operating condition.

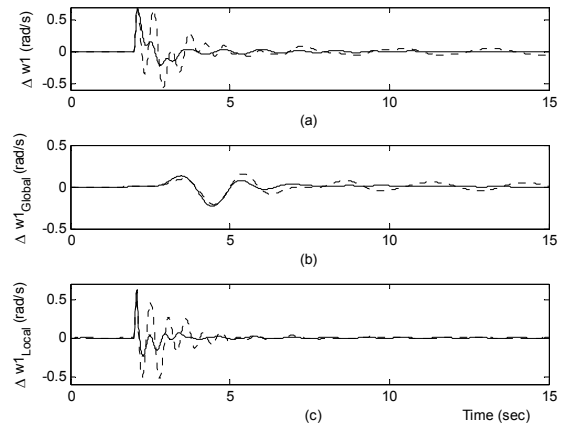


Fig. 11. Oscillation modes analysis, following a fault; a) Speed deviation, b) Global mode, c) fast mode. Solid (H_∞ -SOF), dotted (Conventional AVR-PSS⁽¹⁹⁾)

Table 4. Comparison of H_∞ -based proposed robust control designs

Control design	Control structure	Robust Perf. index	Critical power output
H_∞ -Dynamic	High order	$\gamma = 455.1052$	0.95 (pu)
H_∞ -SOF	Pure gain	$\gamma^* = 456.3110$	0.93 (pu)
AVR-PSS	Conventional	-	0.50 (pu)

6. Conclusion

In order to simultaneous enhancement of power system stability and voltage regulation, a new control strategy is developed using an H_∞ -SOF control technique via a developed iterative LMI algorithm. The proposed method was applied to a four-machine infinite bus power system, and the results are compared with a full-order dynamical H_∞ control design. The performance of the resulting closed-loop system is shown to be satisfactory over a wide range of operating conditions.

Making an effective and direct trade-off between voltage regulation and damping improvement, decentralized property, keeping the fundamental AVR-PSS concepts, ease of formulation for stability and performance requirements and flexibility of design methodology to give a feasible solution are the main advantages of the developed methodology.

Acknowledgments

This work is supported by Japan Society for the Promotion of Science (JSPS) under grant P04346.

References

- (1) P. Kundur, J. Paserba, V. Ajjarapu, G. Andersson, A. Bose, C. Canizares, N. Hatziaargyriou, D. Hill, A. Stankovic, C. Taylor, T. V. Cutsem and V. Vittal: "Definition and classification of power system stability", *IEEE Trans on Power Systems*, vol. 19, no. 2, pp. 1387-1401 (2004)
- (2) F. P. deMello and C. Concordia: "Concept of synchronous machine stability as affected by excitation control", *IEEE Trans PAS*, vol. PAS-88, pp. 316-329 (1969)
- (3) K. T. Law, D. J. Hill and N. R. Godfrey: "Robust co-ordinated AVR-PSS design", *IEEE Trans on Power Systems*, vol. 9, no. 3, pp. 1218-1225 (1994)
- (4) K. T. Law, D. J. Hill and N. R. Godfrey: "Robust controller structure for coordinated power system voltage regulator and stabilizer design", *IEEE Trans on Control Systems Technology*, vol. 2, no. 3, pp. 220-232 (1994)
- (5) V. A. Venikov and V. A. Stroeve: "Power system stability as affected by automatic control of generators-some methods of analysis and synthesis", *IEEE Trans PAS*, vol. PAS-90, pp. 2483-2487 (1971)
- (6) H. M. Soliman and M. M. F. Sakar: "Wide-range power system pole placer", *Inst Elect Eng Proc*, vol. 135, Part C, no. 3, pp. 195-200 (1988)
- (7) O. P. Malik, G. S. Hope, Y. M. Gorski, V. A. Uskakov and A. L. Rackevich: "Experimental studies on adaptive microprocessor stabilizers for synchronous generators", in *IFAC Power System and Power Plant Control*, Beijing, China, pp. 125-130 (1986)
- (8) A. Heniche, H. Bourles, and M. P. Houry: "A desensitized controller for voltage regulation of power systems", *IEEE Trans on Power Systems*, vol. 10, no. 3, pp. 1461-1466 (1995)
- (9) Y. Wang and D. J. Hill: "Robust nonlinear coordinated control of power systems", *Automatica*, vol. 32, no. 4, pp. 611-618 (1996)

- (10) Y. Guo, D. J. Hill and Y. Wang: "Global transient stability and voltage regulation for power systems", *IEEE Trans on Power Systems*, vol. 16, no. 4, pp. 678-688 (2001)
- (11) N. Yadaiah, A. G. D. Kumar and J. L. Bhattacharya: "Fuzzy based coordinated controller for power system stability and voltage regulation", *Electric Power System Research*, vol. 69, pp. 169-177 (2004)
- (12) H. Bevrani, T. Hiyama: "Stability and voltage regulation enhancement using an optimal gain vector", To be published in *IEEE PES General Meeting*, Canada (2006)
- (13) Y. Y. Cao, J. Lam, Y. X. Sun and W. J. Mao: "Static output feedback stabilization: an ILMI approach", *Automatica*, vol. 34, no. 12, pp. 1641-1645 (1998)
- (14) S. P. Boyd, L. El Chaoui, E. Feron and V. Balakrishnan: "Linear matrix inequalities in systems and control theory", Philadelphia, PA: SIAMA (1994)
- (15) P. W. Sauer and M. A. Pai: "Power system dynamic and stability", Englewood Cliffs, NJ; Prentice-Hall (1998)
- (16) P. Gahinet and M. Chilali: " H_∞ -design with pole placement constraints", *IEEE Trans on Automat Control*, vol. 41, no. 3, pp. 358-367 (1996)
- (17) H. Bevrani, T. Hiyama, Y. Mitani and K. Tsuji: "Automatic generation control: a decentralized robust approach", *Intelligent Automation and Soft Computing*, Vol. 12, No. 3, pp. 1-15 (2006)
- (18) H. Bevrani, T. Hiyama: "Robust tuning of PI/PID controllers using H_∞ control technique", in Proc. of the 4th *Int Conf on System Identification and Control Problems*, Moscow, pp. 834-842 (2005)
- (19) T. Hiyama, M. Kawakita, H. Ono: "Multi-agent based wide area stabilization control of power systems using power system stabilizer", in Proc. of *IEEE Int Conf on Power System Technology*, (2004)
- (20) T. Hiyama, and Y. Tsutsumi: "Neural network based adaptive fuzzy logic excitation controller", in Proc. of *IEEE Int Conf on Power System Technology*, vol. 1, pp. 235-240 (2000)
- (21) P. Gahinet, A. Nemirovski, A. J. Laub and M. Chilali: "LMI Control Toolbox", The MathWorks, Inc. (1995)

Appendix

The elements of A_i matrix in (11):

$$a_{21} = - \frac{1}{M_i} \left. \frac{\partial f_{1i}(x)}{\partial x_{1i}} \right|_{x_{ei}}$$

$$a_{23} = - \frac{[G_{ii}E_{qi}^{r'e} - B_{ii}E_{di}^{r'e} + I_{qi}^e]}{M_i} - \frac{1}{M_i} \left. \frac{\partial f_{1i}(x)}{\partial x_{3i}} \right|_{x_{ei}}$$

$$a_{24} = - \frac{[G_{ii}E_{di}^{r'e} + B_{ii}E_{qi}^{r'e} + I_{di}^e]}{M_i} - \frac{1}{M_i} \left. \frac{\partial f_{1i}(x)}{\partial x_{4i}} \right|_{x_{ei}}$$

$$a_{31} = - \frac{\Delta x_{di}}{T'_{d0i}} \left. \frac{\partial f_{2i}(x)}{\partial x_{1i}} \right|_{x_{ei}}, \quad a_{33} = - \frac{1}{T'_{d0i}} + \frac{B_{ii}\Delta x_{di}}{T'_{d0i}}$$

$$a_{41} = - \frac{\Delta x_{qi}}{T'_{q0i}} \left. \frac{\partial f_{3i}(x)}{\partial x_{1i}} \right|_{x_{ei}}, \quad a_{44} = - \frac{1}{T'_{q0i}} + \frac{B_{ii}\Delta x_{qi}}{T'_{q0i}}$$

where,

$$f_{1i}(x) = x_{4i}\Delta I_{di}(x) + x_{3i}\Delta I_{qi}(x) + \sum_{k \neq i} \{ [E_{di}^{r'e}\eta_{ik}(\delta) + E_{qi}^{r'e}\hat{\eta}_{ik}(\delta)]x_{4k} + [E_{di}^{r'e}v_{ik}(\delta) + E_{qi}^{r'e}\hat{v}_{ik}(\delta)]x_{3k} + [E_{di}^{r'e}v_{ik}(\delta) + E_{qi}^{r'e}\hat{v}_{ik}(\delta)]\sin\phi_{ik} \}$$

Table 3. Excitation parameters for units 2, 3 and 4

K_1	K_2	K_3	K_4	$ E_{max(min)} $	U_{max}	U_{min}
1.00	19.21	10.00	6.48	5.71	7.60	-5.20
T_1 (sec)	T_2 (sec)	T_3 (sec)	T_4 (sec)	T_5 (sec)	T_6 (sec)	T_7 (s)
0.010	1.560	0.013	0.013	0.200	3.000	10.000

$$f_{2i}(x) = \sum_{k \neq i} [\eta_{ik}(\delta)x_{4k} + \nu_{ik}(\delta)x_{3k} + \upsilon_{ik}(\delta)\sin\phi_{ik}]$$

$$f_{3i}(x) = \sum_{k \neq i} [\hat{\eta}_{ik}(\delta)x_{4k} + \hat{\nu}_{ik}(\delta)x_{3k} + \hat{\upsilon}_{ik}(\delta)\sin\phi_{ik}]$$

$$\eta_{ik}(\delta) = G_{ik} \cos\delta_{ik} + B_{ik} \sin\delta_{ik}, \hat{\eta}_{ik}(\delta) = B_{ik} \cos\delta_{ik} - G_{ik} \sin\delta_{ik}$$

$$\nu_{ik}(\delta) = G_{ik} \sin\delta_{ik} - B_{ik} \cos\delta_{ik}, \hat{\nu}_{ik}(\delta) = B_{ik} \sin\delta_{ik} - G_{ik} \cos\delta_{ik}$$

$$\upsilon_{ik}(\delta) = 2g_{1ik} \sin \frac{\delta_{ik}^e + \delta_{ik}}{2} + 2g_{2ik} \cos \frac{\delta_{ik}^e + \delta_{ik}}{2}, \phi_{ik} = 0.5(x_{1i} - x_{1k})$$

$$\hat{\upsilon}_{ik}(\delta) = 2g_{2ik} \sin \frac{\delta_{ik}^e + \delta_{ik}}{2} - 2g_{1ik} \cos \frac{\delta_{ik}^e + \delta_{ik}}{2}, \delta_{ik} = \delta_i - \delta_k$$

$$g_{1ik} = G_{ik}E_{dk}^{ie} - B_{ik}E_{qk}^{ie}, g_{2ik} = G_{ik}E_{qk}^{ie} + B_{ik}E_{qk}^{ie}$$

$$\text{Constant weights: } \mu_1 = [500 \quad 5 \quad 0.5 \quad 110]$$

Table 1. Generator constants

Unit No.	M_i (sec)	D_i	x_{di} (pu)	x'_{di} (pu)	x_{qi} (pu)	x'_{qi} (pu)	T'_{d0i} (sec)	T'_{q0i} (sec)	MVA
1	8.05	0.002	1.860	0.440	1.350	1.340	0.733	0.0873	1000
2	7.00	0.002	1.490	0.252	0.822	0.821	1.500	0.1270	600
3	6.00	0.002	1.485	0.509	1.420	1.410	1.550	0.2675	1000
4	8.05	0.002	1.860	0.440	1.350	1.340	0.733	0.0873	900

Table 2. Line parameters

Line No.	Bus-Bus	R_{ij} (pu)	X_{ij} (pu)	S_{ij} (pu)
1	1-9	0.02700	0.1304	0.0000
2	2-10	0.07000	0.1701	0.0000
3	3-11	0.04400	0.1718	0.0000
4	4-12	0.02700	0.1288	0.0000
5	10-6	0.02700	0.2238	0.0000
6	11-7	0.04000	0.1718	0.0000
7	12-8	0.06130	0.2535	0.0000
8	9-10	0.01101	0.0829	0.0246
9	10-11	0.01101	0.0829	0.0246
10	11-12	0.01468	0.1105	0.0328
11	12-5	0.12480	0.9085	0.1640

Hassan Bevrani (Member) received his B.S., M.S. and Ph.D. degrees in Electrical Engineering from Mashad University (Iran, 1991), K. N. Toosi University of Technology (Iran, 1997) and Osaka University (Japan, 2004), respectively. He was working as a postdoctoral fellow at Kumamoto University (Japan) during 2004 to 2006. Currently, he is an assistant professor at the University of Kurdistan (Iran). His special fields of interest include robust load-frequency control and robust/intelligent control applications in Power system and Power electronic industry. He is a member of the Institute of Electrical Engineers of Japan, IEEE and IEE.



Takashi Hiyama (Member) was born on March 14, 1947. He received his B.E., M.S., and Ph.D. degrees all in Electrical Engineering from Kyoto University, in 1969, 1971, and 1980, respectively. Since 1989, he has been a Professor at the Department of the Electrical and Computer Engineering, Kumamoto University. His current interests include the application of intelligent systems to power system operation, management, and control. He is a senior member of IEEE, member of IEE, SICE of Japan and Japan Solar Energy Society.

