



University of Kurdistan

Dept. of Electrical and Computer Engineering Smart/Micro Grids
Research Center
smgrc.uok.ac.ir

Improving Transient Performance of VSG based Microgrids by Virtual FACTS' Functions

Amin Karimi, Yousef Khayat, Mobin Naderi, Rahmatollah Mirzaee, and Hassan Bevrani

Published (to be published) in: **Smart/Micro Grids Research Center, Department of Electrical and Computer Engineering University of Kurdistan**

(Expected) publication date: **March 2019**

Citation format for published version:

Amin Karimi, Yousef Khayat, Mobin Naderi, Rahmatollah Mirzaee, and Hassan Bevrani . (2019).
Improving Transient Performance of VSG based Microgrids by Virtual FACTS' Functions. *Smart Grid Conference (SGC)* (p. 6). Sanandaj, Iran: Smart/Micro Grids Research Center, Department of Electrical and Computer Engineering University of Kurdistan.

Copyright policies:

- Download and print one copy of this material for the purpose of private study or research is permitted.
- Permission to further distributing the material for advertising or promotional purposes or use it for any profitmaking activity or commercial gain, must be obtained from the main publisher.
- If you believe that this document breaches copyright please contact us at smgrc@uok.ac.ir providing details, and we will remove access to the work immediately and investigate your claim.

Improving Transient Performance of VSG based Microgrids by Virtual FACTS' Functions

Amin Karimi, Yousef Khayat, Mobin Naderi, Rahmatollah Mirzaee, and Hassan Bevrani
Smart/Micro Grids Research Center, Department of Electrical and Computer Engineering
University of Kurdistan
Sanandaj, Iran

A.karimi865@gmail.com, y.khayat@eng.uok.ac.ir, m.naderi@eng.uok.ac.ir, r_mirzaee@yahoo.com,
h.bevrani@gmail.com

With the advent of VSGs, the challenge of improving the transient state in systems based on VSG remains. This subject

Abstract— This report presents a transient proportional controller which is augmented on virtual inertia's topology. The concept of virtual synchronous generator (VSG) is inspired by the behavior of the synchronous generators and researchers map this behavior on microgrids to mimic the power system's dynamics on microgrids. The added characteristic is based on FACTS' functions such as: STATCOM swing damping capability for largesignal disturbance damping at transient times, for VSG based microgrids. This capability is added to the VSG structure by a bang-bang controller. The proposed bang-bang controller is used to improve transient response of VSG based microgrids just in large signal disturbances, including: islanding, three-phase faults, and huge variation of loads. Simplicity and capability to improve the transient response are the main features of the added configuration. Simulation results verify the improvement of the introduced manner by the represented augmented VSG control strategy.

Index Terms—AC microgrids, FACTS, transient performance improvement, virtual inertia, virtual synchronous generator.

I. INTRODUCTION

Immense use from renewable energy sources (RESs), in Electric power generation system especially microgrids has been obvious. The lack of RES inertia in islanded microgrids, leads to increment of variations in system frequency. Thus recently virtual inertia (VI), has drawn great attention, which VSG is one of its most prominent examples as a solution [1], [2].

In conventional power systems which used synchronous generator (SG), due to the inertia of SG, fluctuation in active and reactive power may be occurred. Resolutely, power system stabilizer (PSS) is used in SG to solve this problem. In conventional power systems, the PSS is responsible for damping of plausible fluctuation in active and reactive power caused by the inertia of SG. Due to complex and vague nature of power system, specifying, tuning and an appropriate control parameters by PSS is difficult. Define the appropriate control parameters for VSG in the case of VSGs is not so easy too.

978-1-5386-4279-5/17/\$31.00 ©2017 IEEE

was explored by several papers. Transient state improvement in microgrids by VSG, have been addressed in a more last publication [3], [4]. In [5], the online optimization manner determines optimum damping coefficient and VI's parameters in swing equation. Reactive power sharing strategy in VSG based microgrids, is provides by virtual capacitor algorithm in [6]. Reduction of reactive power sharing error, and rectification of the voltage control accuracy meantime, without communication and system parameters detection are achieved by mentioned algorithm. In [7], a virtual inertia control strategy for DC microgrids through the introduced bidirectional gridconnected converters analogized with the virtual synchronous machine in AC microgrid is proposed to enhance the inertia of the DC microgrid, and to restrain the dc bus voltage fluctuation. In order to elevate the inertia of the DC microgrid and to harness the dc bus voltage oscillation, two topics of presence of virtual synchronous machine in AC microgrids and DC microgrids through the introduced bidirectional grid-connected converters are compared by a virtual inertia control strategy.

In [8], using the VSG based on linearizing method which works out the output power fluctuation, transient state fluctuation is developed for a DG, but active and reactive power sharing not investigated. In fact by using the VSG concept for a distributed generator, the grid oscillations is damped. Finally a damping control manner consists of the system linearized equation, decoupling the voltage deviation, damping factor and linear control theory is proposed.

In [9], by regulation of the virtual stator reactance, fluctuation damping and appropriate transient active power sharing are achieved. Also by V- Q droop control and common ac bus voltage estimation, suitable reactive power sharing is achieved. In [10], analogy of dynamic specifications between VSG and droop control in inverter-based distributed generators is proposed. But the discrepancy on inertia, transient frequency, and reactive power control issue are not considered. In [11], usual VSG control based modular multilevel inverters are

output voltage and calculated line voltage drop, estimates the bus voltage. As discussed in[9], to clarify the explication for the cases with different power ratings, per unit values are considered based on respective power ratings of DGs. In order to share the active and reactive powers according to the ratings of DGs without communication.

III. IMPROVEMENT OF TRANSIENT STABILITY WITH PHASE ANGLE REGULATORS

Based on [21], [22], power oscillation damping is achieved by varying the active power flow in the line(s) so as to counteract the accelerating and decelerating swings of the disturbed machine(s). That is, when the rotationally oscillating generator accelerates and angle increases ($\dot{\delta} > 0$), the electric power transmitted must be increased to compensate for the excess mechanical input power. Conversely, when the generator decelerates and angle decreases ($\dot{\delta} < 0$), the electric power must be decreased to balance the insufficient mechanical input power. The requirements of output control and the process of power oscillation damping by transmission angle control are illustrated at Fig. 2. Waveforms show the undamped and damped oscillations of angle around the steady-state value. Waveforms at (b) show the undamped and damped oscillations of the electric power P around the steady-state value P_0 . The momentary drop in power shown in the figure represents an assumed disturbance that initiated the oscillation.

As illustrated, a "bang-bang" type control (in which the output value of controller is varied between minimum and maximum values) is the simplest and most effective if large oscillations are encountered. However, for damping relatively small power oscillations, continuous variation of the angle may be preferred.

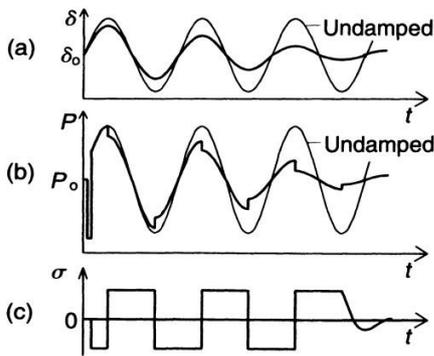


Fig. 2 Waveforms illustrating power oscillation damping by phase angle control: (a) generator angle, (b) transmitted power, and (c) phase shift provided by the Phase Angle Regulator [22].

IV. POWER OSCILLATION DAMPING BY REACTIVE POWER INJECTION

Fig. 3 shows that how we can damp the active power oscillation by injecting reactive power. As it is shown, the reactive power output is controlled in a "bang-bang" manner (output is varied between the minimum and maximum values). This method of control is generally considered as the most effective and simplest manner, particularly if large oscillations are encountered. However, for damping relatively small power oscillations, a strategy that varies the controlled output of the

compensator continuously, in sympathy with the generator angle or power, may be preferred. This manner, is

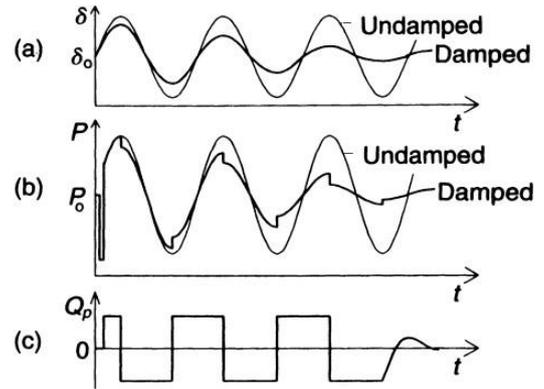


Fig. 3 Waveforms illustrating power oscillation damping by reactive shunt compensation: (a) generator angle, (b) transmitted power, and (c) variable output of the shunt compensator [22].

V. APPLYING TO VSG BASED MICROGRIDS

Now, by the variations of the angle of δ , we can propose a proportional controller which just applied only in transient times, in simple terms only when the angle of δ violates its bounds.

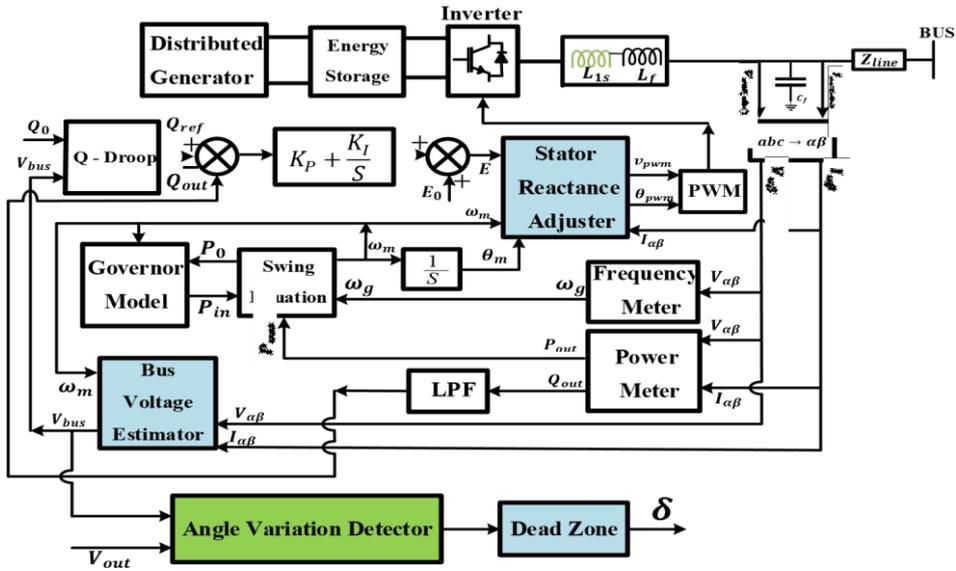


Fig. 4. Block diagram of a basic VSG control configuration with angle variation detection

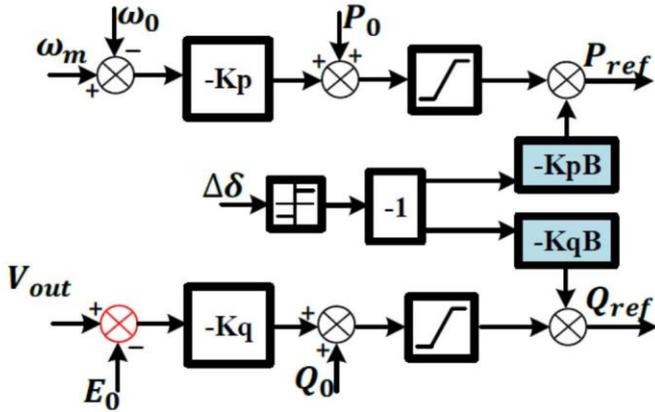


Fig. 5 The governor and the Q-droop blocks augmented by bang-bang proportional control

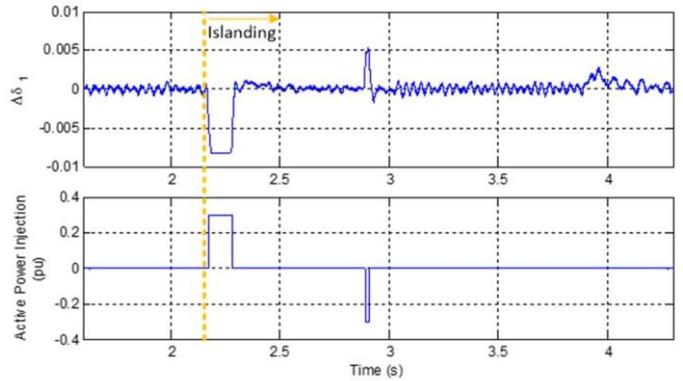


Fig. 6. Power angle detection in transient times and active power injection (Like islanding or huge load changes, and or when a fault occurs) occurs in microgrids.

VI. SIMULATION RESULTS

In order to test the designed proportional controller on the reactive and active power loops, it is enough to close the represented approaches on the VSG configuration. The case study and information about the VSG based test microgrid is

For this end, assuming that a basic VSG structure is fully notified, just by adding a block to detection of δ is needed which is shown in Fig. 4. Actually in this block (angle variation detector), two PLL is used to obtain δ . Also, a dead-bound block is used to filter the steady state small variation of δ . By obtaining variations of δ , i.e. $\Delta\delta$, based on section 1 and 2, a sign function needs to implement the bang-bang control like the Fig. 5, to inject active and reactive power in transient times when a large-scale change

addressed in [9]. All the simulation parameters and scenarios are like with [9], too.

As it is illustrated in Figs. 6, when the microgrid is islanded at 2.1 s, and when load 2 is connected at 2.8 s, oscillations on power angle can be observed in transient times. By detection of these oscillations, the bang-bang controller injects appropriate active and reactive power to reference values of active and reactive power, regarded as its K_p and K_q coefficients.

In active power, when the basic VSG control is applied for both DGs, this oscillation is almost eliminated by applying the proposed augmented VSG control with FACTS' functions shown in Fig. 7. However, the disturbance which is applied at 3.8 s caused by change of active power set value of DG1, is not a loading transition, and there are not any compensated signal to add on set points of active and reactive power.

Meanwhile, the oscillation periods become shorter, because the damped natural frequencies are decreased as it is discussed.

Note that the rate of change of frequency doesn't remain the same in transients, which suggests that the proposed augmented VSG control has a significance influence on the inertia support feature of VSG control, which it can change the system inertia.

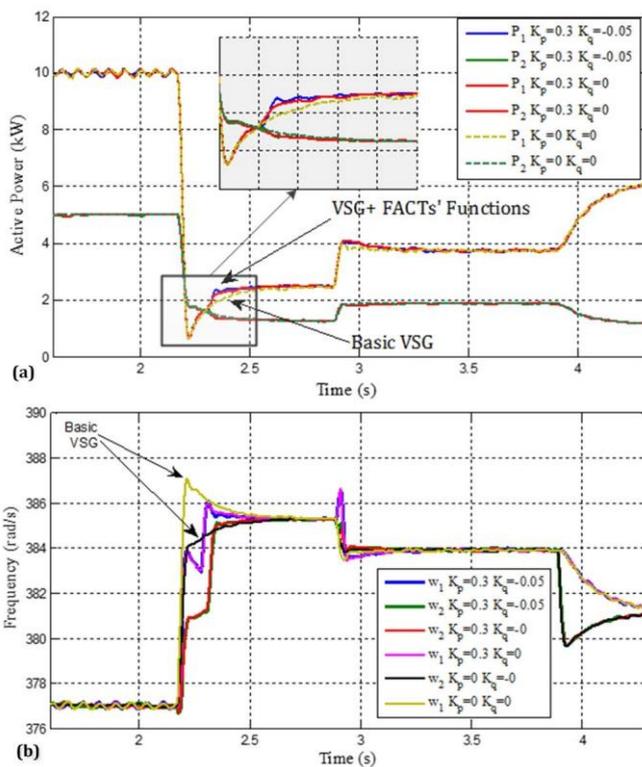


Fig. 7. Simulation results of active power (a), and frequency (b), when both DGs are controlled by the basic VSG control, and augmented by the coefficients of active and reactive power injection by the proposed controller.

VII. CONCLUSION

In order to appropriately integrate renewable energy to mimic the power system behavior with a favorable inertia, a virtual inertia topology is needed. The challenges faced in this case will be more if the transient performance will be bold. A control strategy based on FACTS' functions was augmented on VSG topology to take advantage of the transient performance improvement. Taking advantages of the better performance and

the much greater flexibility attained by the tunable "virtual" parameters related to FACTS' functions in the proposed loop. Analysis of a simple bang-bang controller augmented on a VSG based microgrid was discussed and the comparison with previous works showed a better transient performance potential and preferable characteristic in the small signal stability. The proposed method was evaluated against the conventional VSG topology under frequency deviations, and active and reactive power fluctuations, where it showed a significantly improved regulation and damping performance. The stability and performance enhancement by the VSG-based microgrids will be an important issue under high penetration of renewable energy and will be further explored to augment them by inspiration with power system behavior in the future work.

VIII. REFERENCES

- [1] H. Bevrani, *MICROGRID CONTROL : a solution for integration of renewable power*. JOHN WILEY, 2017.
- [2] H. Bevrani, T. Ise, and Y. Miura, "Virtual synchronous generators: A survey and new perspectives," *Int. J. Electr. Power Energy Syst.*, vol. 54, pp. 244–254, Jan. 2014.
- [3] N. Soni, S. Doolla, and M. C. Chandorkar, "Improvement of Transient Response in Microgrids Using Virtual Inertia," *IEEE Trans. Power Deliv.*, vol. 28, no. 3, pp. 1830–1838, Jul. 2013.
- [4] B. Rathore, S. Chakrabarti, and S. Anand, "Frequency response improvement in microgrid using optimized VSG control," in *2016 National Power Systems Conference (NPSC)*, 2016, pp. 1–6.
- [5] M. A. Torres L., L. A. C. Lopes, L. A. Moran T., and J. R. Espinoza C., "Self-Tuning Virtual Synchronous Machine: A Control Strategy for Energy Storage Systems to Support Dynamic Frequency Control," *IEEE Trans. Energy Convers.*, vol. 29, no. 4, pp. 833–840, Dec. 2014.
- [6] H. Xu, X. Zhang, F. Liu, R. Shi, C. Yu, and R. Cao, "A Reactive Power Sharing Strategy of VSG Based on Virtual Capacitor Algorithm," *IEEE Trans. Ind. Electron.*, vol. 64, no. 9, pp. 7520–7531, Sep. 2017.
- [7] W. Wu, Y. Chen, A. Luo, L. Zhou, X. Zhou, L. Yang, Y. Dong, and J. M. Guerrero, "A Virtual Inertia Control Strategy for DC Microgrids Analogized With Virtual Synchronous Machines," *IEEE Trans. Ind. Electron.*, vol. 64, no. 7, pp. 6005–6016, Jul. 2017.
- [8] T. Shintai, Y. Miura, and T. Ise, "Oscillation Damping of a Distributed Generator Using a Virtual Synchronous Generator," *IEEE Trans. Power Deliv.*, vol. 29, no. 2, pp. 668–676, Apr. 2014.
- [9] J. Liu, Y. Miura, H. Bevrani, and T. Ise, "Enhanced Virtual Synchronous Generator Control for Parallel Inverters in Microgrids," *IEEE Trans. Smart Grid*, vol. 8, no. 5, pp. 2268–2277, Sep. 2017.
- [10] J. Liu, Y. Miura, and T. Ise, "Comparison of Dynamic Characteristics Between Virtual Synchronous Generator and Droop Control in Inverter-Based Distributed Generators," *IEEE Trans. Power Electron.*, vol. 31, no. 5, pp. 3600–3611, May 2016.
- [11] C. Li, J. Xu, and C. Zhao, "A Coherency-Based Equivalence Method for MMC Inverters Using Virtual Synchronous Generator Control," *IEEE Trans. Power Deliv.*, vol. 31, no. 3, pp. 1369–1378, Jun. 2016.
- [12] Q.-C. Zhong and G. Weiss, "Synchronverters: Inverters That Mimic Synchronous Generators," *IEEE Trans. Ind. Electron.*, vol. 58, no. 4, pp. 1259–1267, Apr. 2011.
- [13] H. Wu, X. Ruan, D. Yang, X. Chen, W. Zhao, Z. Lv, and Q.-C. Zhong, "Small-Signal Modeling and Parameters Design for Virtual Synchronous Generators," *IEEE Trans. Ind. Electron.*, vol. 63, no. 7, pp. 4292–4303, Jul. 2016.
- [14] L.-Y. Lu and C.-C. Chu, "Consensus-Based Secondary Frequency and Voltage Droop Control of Virtual Synchronous Generators for Isolated AC Micro-Grids," *IEEE J. Emerg. Sel. Top. Circuits Syst.*, vol. 5, no. 3, pp. 443–455, Sep. 2015.
- [15] J. Alipoor, Y. Miura, and T. Ise, "Power System Stabilization Using Virtual Synchronous Generator With Alternating Moment of Inertia," *IEEE J. Emerg. Sel. Top. Power Electron.*, vol. 3, no. 2, pp. 451–458, Jun. 2015.
- [16] S. Filizadeh and A. M. Gole, "Harmonic Performance Analysis of an OPWM-Controlled STATCOM in Network Applications," *IEEE Trans. Power Deliv.*, vol. 20, no. 2, pp. 1001–1008, Apr. 2005.

- [17] M. H. Haque, "Improvement of First Swing Stability Limit by Utilizing Full Benefit of Shunt FACTS Devices," *IEEE Trans. Power Syst.*, vol. 19, no. 4, pp. 1894–1902, Nov. 2004.
- [18] P. Wang, N. Jenkins, and M. H. J. Bollen, "Experimental investigation of voltage sag mitigation by an advanced static VAR compensator," *IEEE Trans. Power Deliv.*, vol. 13, no. 4, pp. 1461–1467, 1998.
- [19] B. Singh and J. Solanki, "A Comparison of Control Algorithms for DSTATCOM," *IEEE Trans. Ind. Electron.*, vol. 56, no. 7, pp. 2738–2745, Jul. 2009.
- [20] C. Schauder, M. Gernhardt, E. Stacey, T. Lemak, L. Gyugyi, T. W. Cease, and A. Edris, "Development of a ± 100 MVar static condenser for voltage control of transmission systems," *IEEE Trans. Power Deliv.*, vol. 10, no. 3, pp. 1486–1496, Jul. 1995.
- [21] K. Al-Haddad, R. Saha, A. Chandra, and B. Singh, "Static synchronous compensators (STATCOM): a review," *IET Power Electron.*, vol. 2, no. 4, pp. 297–324, Jul. 2009.
- [22] N. G. Hingorani and L. Gyugyi, *Understanding FACTS : concepts and technology of flexible AC transmission systems*. IEEE Press, 2000.